


**PLAN**

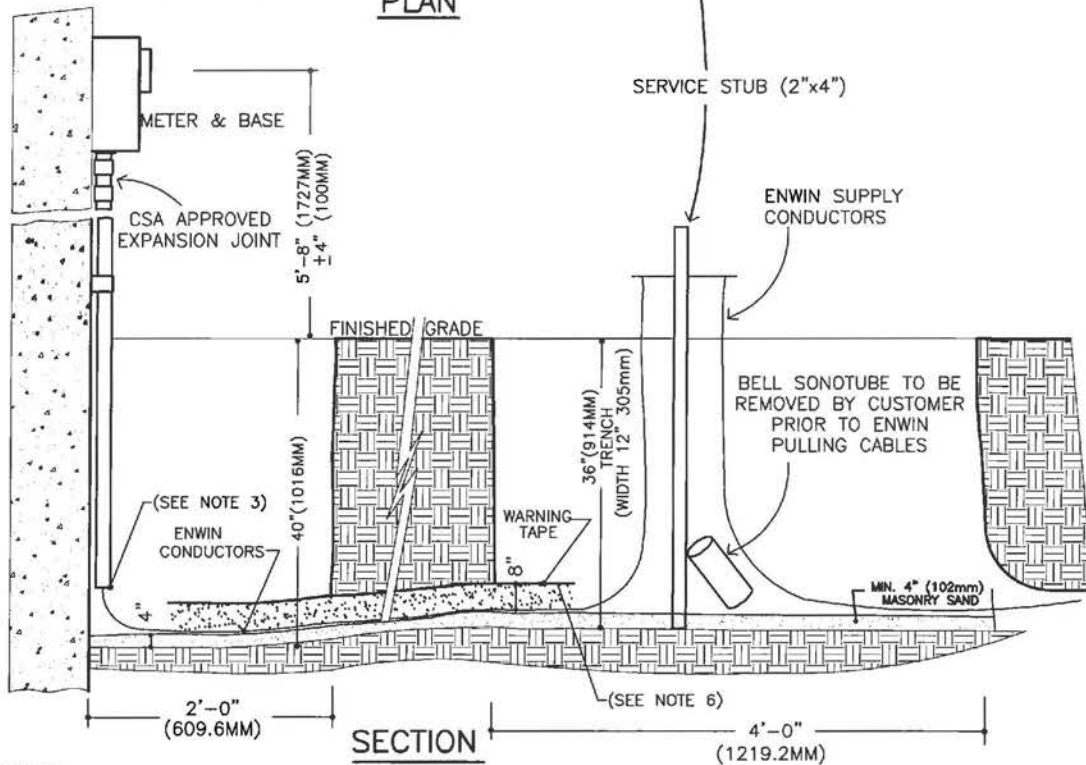

**SECTION**

**NOTES:**

1. EXCAVATIONS BY OWNER TO ENABLE INSTALLATION OF SERVICE CABLE BY ENWIN.
2. IN ADDITION TO THE 4" (100mm) OF BASE SAND, THE CUSTOMER IS TO PROVIDE ADDITIONAL MASONRY SAND ON SITE FOR 8" (203mm) BACKFILL OF COMPLETE CABLE. SAND TO BE PLACED IN (1CU. YARD) PILES ALONG TRENCH AT SERVICE STUB EXCAVATION, AT WALL AND MINIMUM OF 1 POINT ALONG TRENCH OR MAX. OF 15' OR 5m PILE SPACING.
3. IF LIP OF CONCRETE FOUNDATION OBSTRUCTS THE OPENING OF THE DUCT, INCLUDE 2"-45' SWEEP.
4. FOLLOWING INSTALLATION, THE CUSTOMER SHALL ASSUME RESPONSIBILITY FOR ANY FUTURE REPAIRS TO HYDRO METER BASE OR CONDUITS.
5. STUB SHALL BE ENTIRELY REMOVED DURING EXCAVATION WITHOUT DAMAGING CONDUCTORS. EXCAVATION OF BELL SONOTUBE IS ALSO RESPONSIBILITY OF CUSTOMER.
6. IF CUSTOMERS SERVICE IS TO CONNECT TO A DISTRIBUTION POLE SEE DWG SG-10-B.

**TITLE**  
**RESIDENTIAL UNDERGROUND SERVICE ENTRANCE WITH DIRECT BURIED**

REVISION  
 20-APR-15

APPROVED  
*MS*



STD. DWG. NO. 69-1-1  
 SERVICE GUIDE FIGURE 2.1A SG-14  
 CAD FILE NAME 69-1-1